

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT				1. CONTRACT ID CODE		PAGE OF PAGES		
2. AMENDMENT/MODIFICATION NO.			3. EFFECTIVE DATE		4. REQUISITION/PURCHASE REQ. NO.		5. PROJECT NO. (If applicable)	
6. ISSUED BY			CODE		7. ADMINISTERED BY (If other than Item 6)		CODE	
8. NAME AND ADDRESS OF CONTRACTOR (No., street, county, State and ZIP Code)				(X)		9A. AMENDMENT OF SOLICITATION NO.		
						9B. DATED (SEE ITEM 11)		
						10A. MODIFICATION OF CONTRACT/ORDER NO.		
						10B. DATED (SEE ITEM 11)		
CODE			FACILITY CODE					
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS								
<input type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers <input type="checkbox"/> is extended, <input type="checkbox"/> is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing items 8 and 15, and returning _____ copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment your desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.								
12. ACCOUNTING AND APPROPRIATION DATA (If required)								
13. THIS ITEM ONLY APPLIES TO MODIFICATION OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.								
CHECK ONE	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.							
	B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).							
	C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:							
	D. OTHER (Specify type of modification and authority)							
E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input type="checkbox"/> is required to sign this document and return _____ copies to the issuing office.								
14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)								
15A. NAME AND TITLE OF SIGNER (Type or print)				16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)				
15B. CONTRACTOR/OFFEROR				15C. DATE SIGNED		16B. UNITED STATES OF AMERICA		
15C. DATE SIGNED				16B. UNITED STATES OF AMERICA		16C. DATE SIGNED		
(Signature of person authorized to sign)				(Signature of Contracting Officer)				

Amendment 0001 is hereby incorporated into solicitation SP3100-08-B-5011 and shall become part of any contract.

Amendment 0001 is being issued to add additional work to the requirements of solicitation SP3100-08-B-5011 and to correct a typographical error in the specifications.

1. Reference Building 69-Project No. 3629 HVAC System Improvements Building 69

The following work is hereby added:

Replace the existing 275 gallon single wall fuel storage tank with a new 275 gallon double wall fuel storage tank. The new fuel storage tank shall comply with NFPA 30, NFPA 31 and UL 142.

2. Reference Building 286-Project No. 3628 HVAC System Improvements Building 286

The following work is hereby added:

Building 287: Install new gas meter in existing gas service. UGI line is a 1-1/4" sch 40 line. Use 1-1/4" line into and out of meter installation and then install a 1-1/4" x 1" reducer onto existing gas line. Install pipe unions as needed. See attached typical detail and photos.

Building 286:


Install new gas meter into new gas service piping for building 286. See attached typical detail and photos.

3. Delete reference to specification sections 15183 and 15569 found in the table of contents pages of Building 286 specification. Specification sections 15183 and 15569 are not required for either building 69 or 286.

The proposal due date and time remains September 22, 2008, 2:00 PM., Building 404.

All other terms and conditions remain unchanged.

END OF AMENDMENT 0001

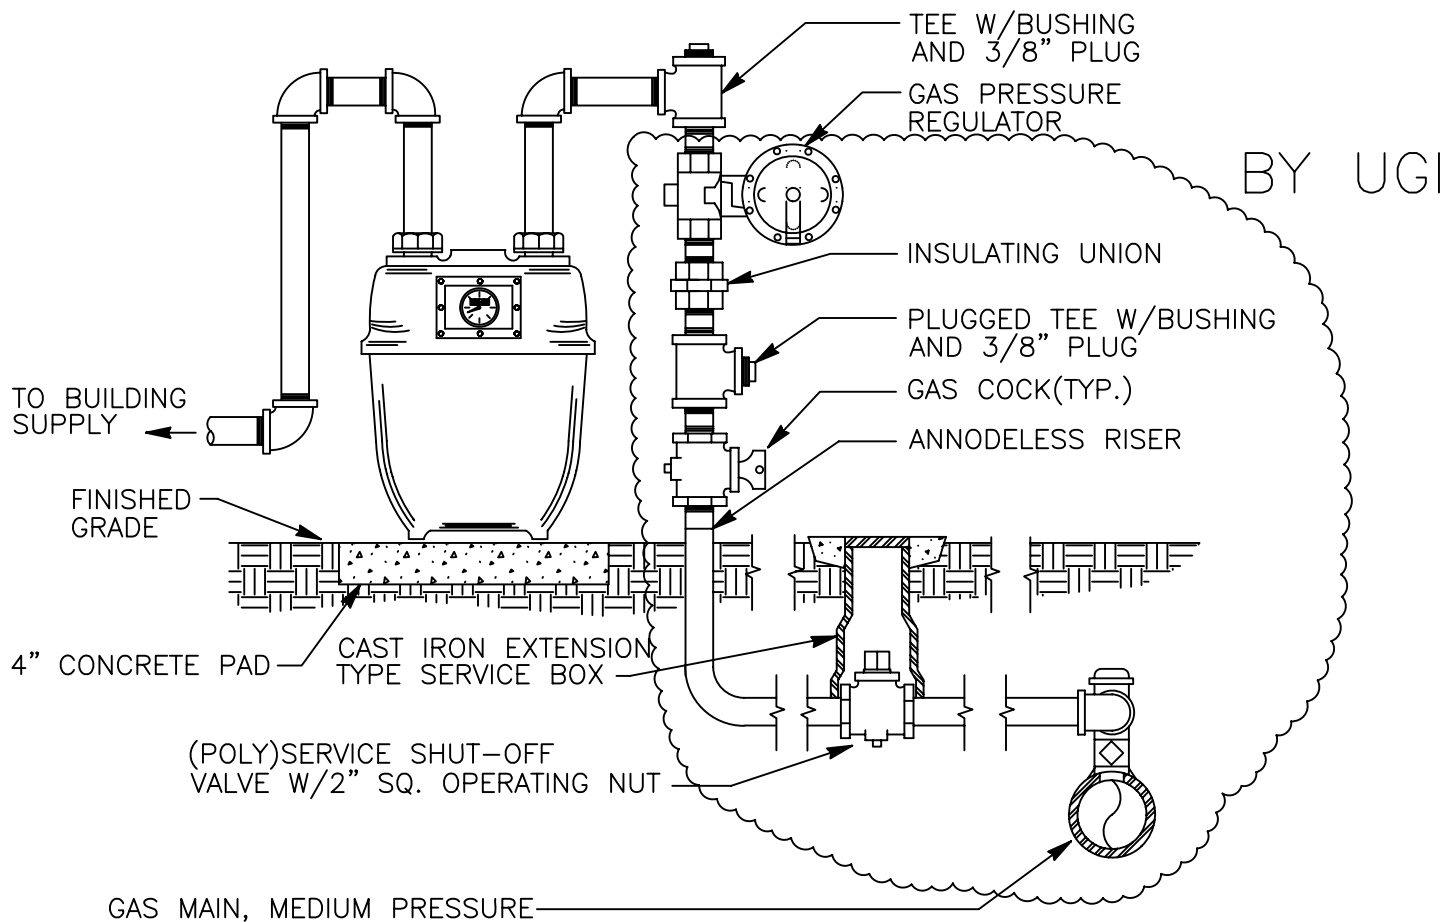

NOTE: LINE SIZES AS CALLED FOR ON SITE PLAN

GAS SERVICE CONNECTION DETAIL

NO SCALE

NOTE: METER AND UNDERGROUND GAS
SUPPLY LINE SHALL BE BY OTHERS.
CONTRACTOR SHALL SUPPLY GAS PIPING
FROM BOILER TO METER LOCATION.

METER: AMERICAN METER CO.
AL-425 425 CFH @ 1/2" DIFFERENTIAL
10 PSI MAX. ANSI CLASS 400
TEMPERATURE COMPENSATED



09/05/2008 09:43



09/05/2008 09:43



09/05/2008 09:44